


secondary trench to padmount transformer



NOTE: Clark Public Utilities personnel will route wire into energized facilities.

secondary trench to secondary pedestal

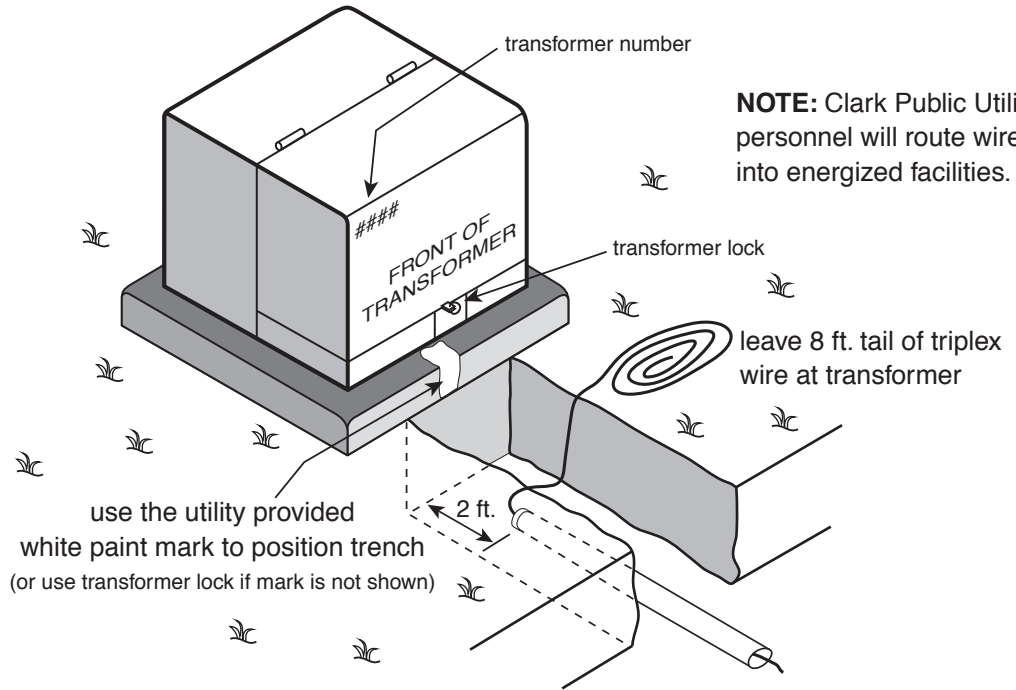