


**Figure 10** Two types of meter bases for residential underground service



**NOTE:** Flush-mounted service entrance conduit cannot be located in a shear wall or within 4 ft. of a structure corner.

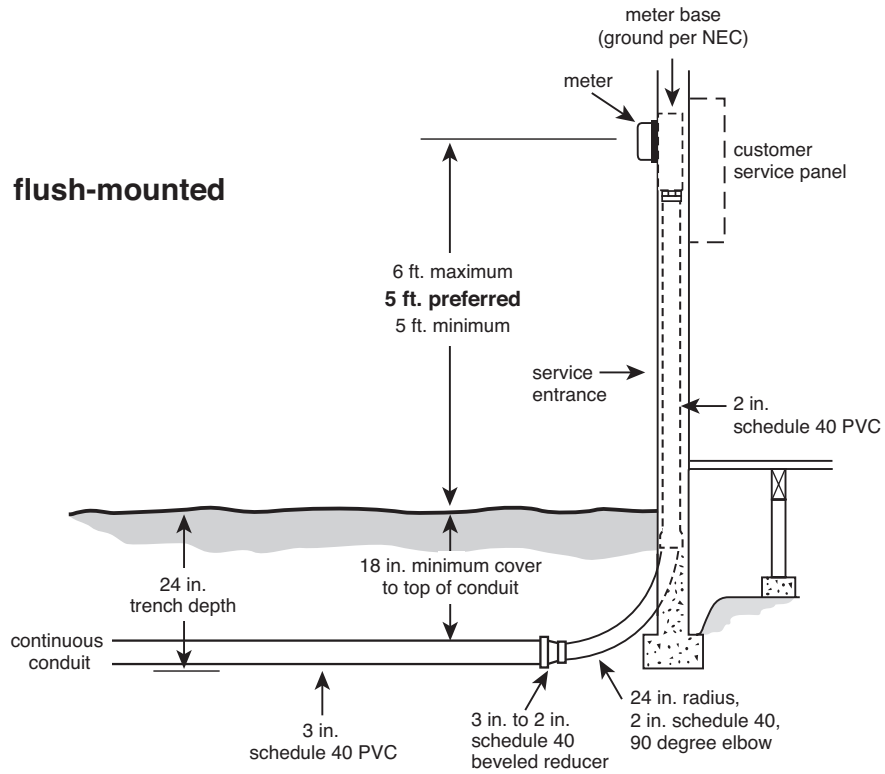