


TRENCH TO SECONDARY PEDESTAL

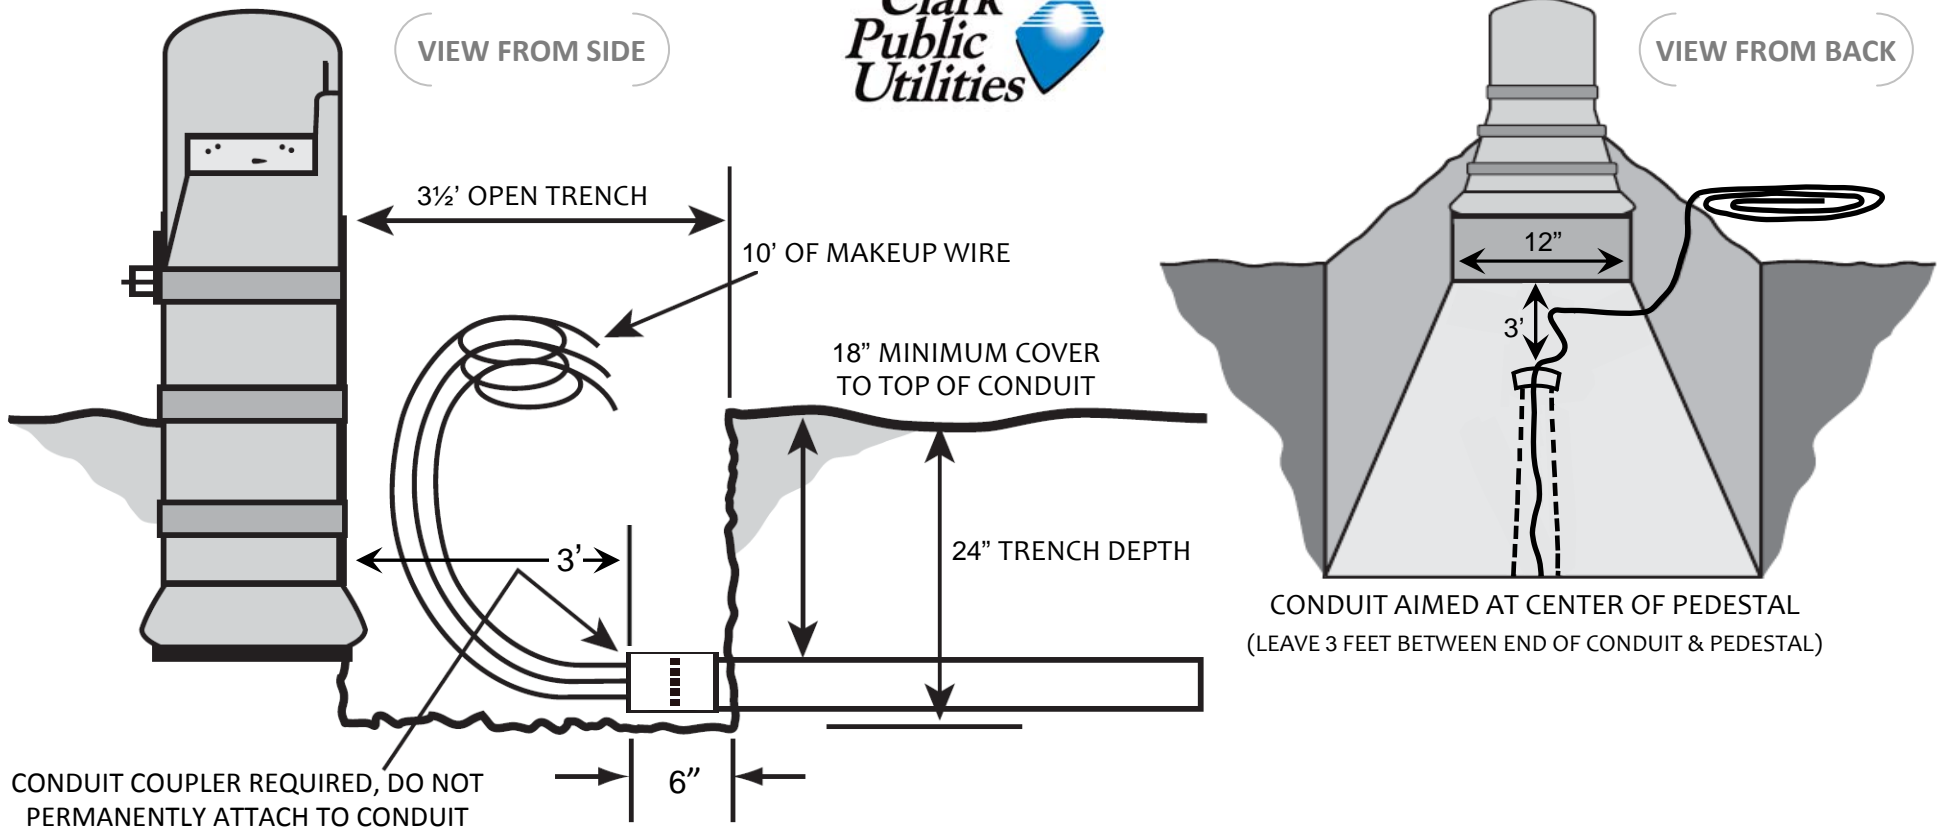

- DIG OUT TRENCH AS SHOWN IN DIAGRAM
- REQUIRED TRENCH DEPTH IS 24" (THIS INCLUDES THE PORTION LEFT OPEN FROM THE END OF THE CONDUIT TO THE BASE OF THE PEDESTAL)
- ELECTRIC SERVICE BLOCKED BY ANOTHER UTILITY
- STOP CONDUIT 3 FEET BACK FROM BASE OF PEDESTAL
- CONSTRUCTION DEBRIS IN TRENCH
- MINIMUM TRENCH WIDTH IS 12"
- NO ACCESS TO PANEL
- PANEL COVER MISSING
- LEAVE 6" OF CONDUIT EXPOSED (REMOVE ALL DIRT FROM TOP AND SIDES)
- CONDUIT NOT AIMED AT CENTER OF ELECTRICAL PEDESTAL
- OTHER: _____

**CALL CLARK PUBLIC UTILITIES
CONSTRUCTION SERVICES (360) 992-8558
AFTER INDICATED CORRECTIONS ARE COMPLETE**

MULTIPLE TRIPS TO THE SAME JOB SITE MAY RESULT IN A TRIP FEE