


**ABOVE GROUND  
INSTALLATION**

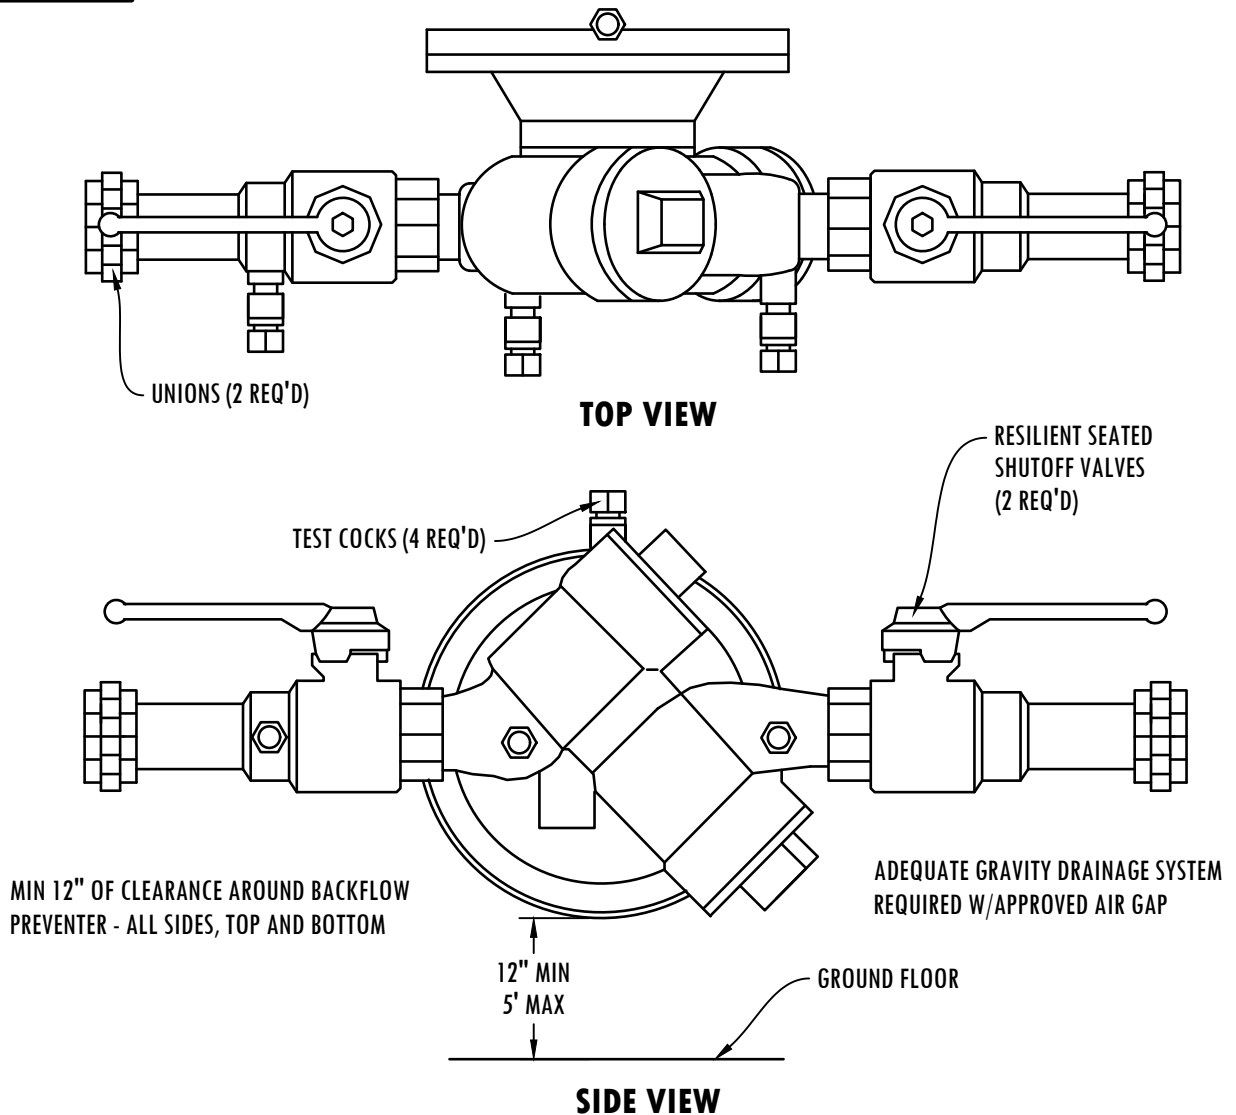

**NOTES:**

1. APPROVED REDUCED PRESSURE BACKFLOW ASSEMBLY TO BE INSTALLED ABOVE GROUND WITH MINIMUM CLEARANCES.
2. DESIGNED FOR BACK SIPHONAGE AND BACK PRESSURE.
3. TEST COCKS TO EITHER FACE OUTWARDS OR UPWARDS FROM ASSEMBLY.
4. DISINFECT, PRESSURE TEST AND THOROUGHLY FLUSH LINES PRIOR TO INSTALLATION OF BACKFLOW PREVENTER.
5. DO NOT INSTALL IN AN AREA SUBJECT TO FLOODING.
6. MUST BE PROTECTED FROM FREEZING CONDITIONS.
7. THE BACKFLOW ASSEMBLY SHALL BE A STATE APPROVED MODEL.
8. A PLUMBING PERMIT IS REQUIRED. PLEASE CONTACT YOUR LOCAL PLUMBING PERMIT CENTER.
9. MUST BE TESTED AFTER INSTALLATION AND YEARLY THEREAFTER BY A WASHINGTON STATE CERTIFIED BACKFLOW ASSEMBLY TESTER. TEST RESULTS SHALL BE SENT TO CLARK PUBLIC UTILITIES WATER SERVICES.
10. ABOVE GROUND INSTALLATION REQUIRED.

REVISED 04/17/2020

|                  |               |  |   |
|------------------|---------------|--|---|
| <b>FILE NAME</b> |               | <b>STANDARD RPBA<br/>(REDUCED PRESSURE BACKFLOW ASSEMBLY)<br/>2" &amp; SMALLER</b> | <b>Clark<br/>Public<br/>Utilities</b>  |
| <b>21W</b>       |               |  |   |
| <b>SHEET</b>     | <b>1 OF 1</b> | <b>STANDARD DETAILS</b>  |   |