


**ABOVE GROUND  
INSTALLATION**

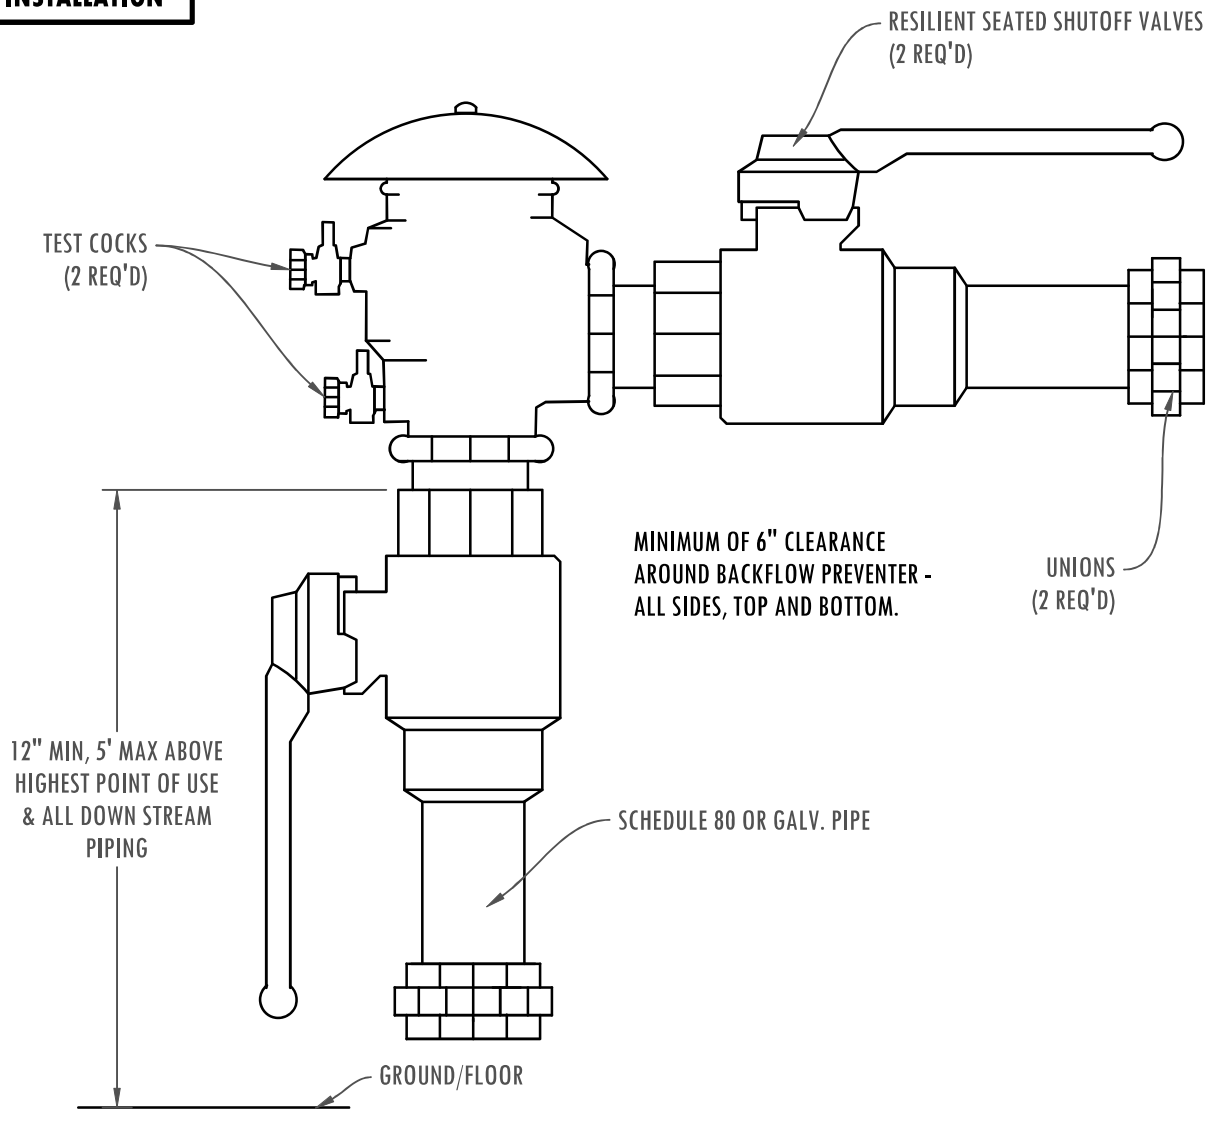

1. APPROVED PRESSURE VALVE BREAKER ASSEMBLY MUST BE INSTALLED VERTICALLY, 12" MIN TO 5' MAX ABOVE THE HIGHEST POINT OF USE AND ALL DOWNSTREAM PIPING.
2. DESIGNED FOR BACK SIPHONAGE ONLY, NOT BACK PRESSURE.
3. DISINFECT, PRESSURE TEST AND THOROUGHLY FLUSH LINES PRIOR TO INSTALLATION OF BACKFLOW PREVENTER.
4. IF A PVBA IS INSTALLED INDOORS, CONSIDERATION MUST BE GIVEN TO WATER LEAKAGE IF THE BACKFLOW PREVENTER FAILS (EXCESSIVE WATER SPILLAGE).
5. THE BACKFLOW ASSEMBLY SHALL BE PROTECTED FROM FREEZING AND FLOODING.
6. THE BACKFLOW ASSEMBLY SHALL BE A STATE APPROVED MODEL.
7. A PLUMBING PERMIT IS REQ'D. PLEASE CONTACT YOUR LOCAL PLUMBING PERMIT CENTER.
8. MUST BE TESTED AFTER INSTALLATION AND YEARLY THEREAFTER BY A WASHINGTON STATE CERTIFIED BACKFLOW ASSEMBLY TESTER. TEST RESULTS SHALL BE SENT TO CLARK PUBLIC UTILITIES WATER SERVICES.

REVISED JANUARY 2025

<b>FILE NAME</b>		<b>STANDARD PVBA (PRESSURE VACUUM BREAKER ASSEMBLY) 2" &amp; SMALLER</b>	<b>Clark Public Utilities</b> 
<b>19W</b>			
<b>SHEET</b>	<b>1 OF 1</b>	<b>STANDARD DETAILS</b>	