


# METERED TEMPORARY ELECTRIC SERVICE - UNDERGROUND FEED

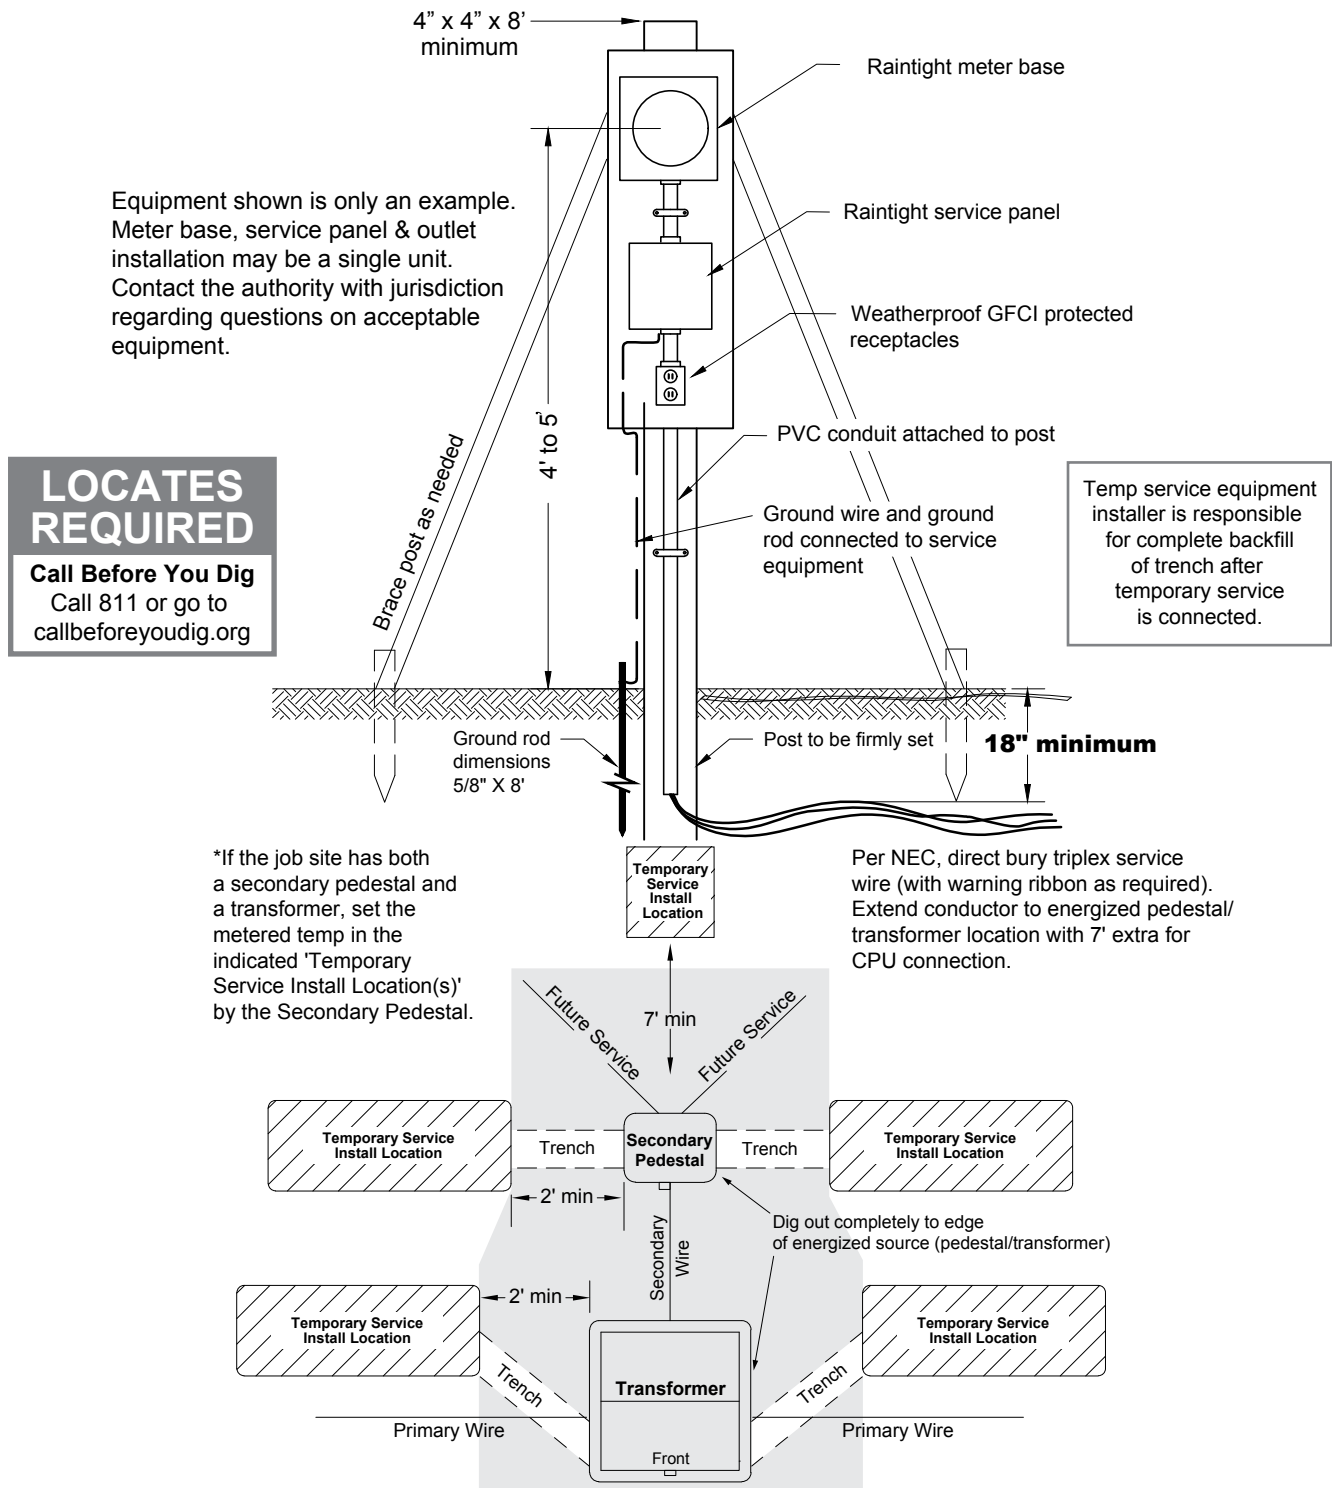

## **DO NOT INSTALL TEMPORARY SERVICE EQUIPMENT IN GREY AREA**

Temporary electric service equipment and installation must meet NEC requirements and pass inspection by the authority having jurisdiction before Clark Public Utilities can set a meter and energize the service.

**NOTE:** If source equipment is **not** energized, temporary service wire must be landed and tagged in the source facility by the contractor setting the temporary service equipment.