

ABOVE GROUND INSTALLATION ONLY

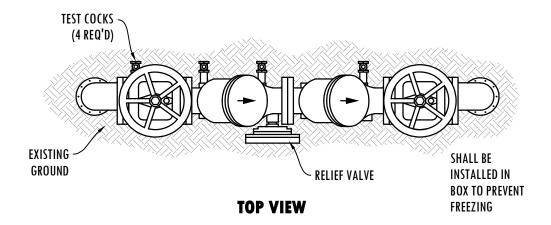

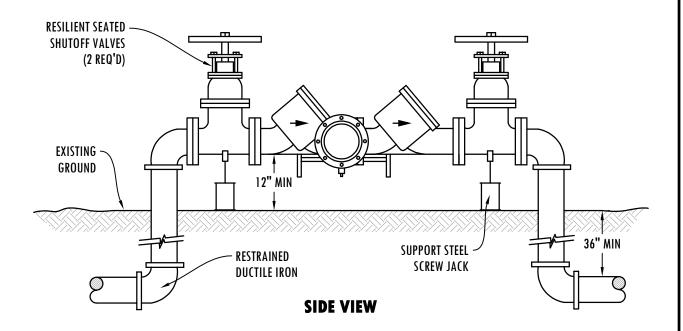

NOTES:

- 1. APPROVED BACKFLOW ASSEMBLIES TO BE INSTALLED ABOVE GROUND ONLY WITH MINIMUM CLEARANCES.
- 2. THE BACKFLOW ASSEMBLY SHALL BE A STATE APPROVED MODEL.
- 3. DESIGNED FOR BACK SIPHONAGE AND BACK PRESSURE.
- 4. THE WATER LINE SHALL BE DISINFECTED, FLUSHED, AND PRESSURE TESTED PRIOR TO INSTALLING THE BACKFLOW ASSEMBLY.
- 5. THE BACKFLOW ASSEMBLY SHALL BE PROTECTED FROM FREEZING AND FLOODING INSIDE AN INSULATED BOX COMMONLY REFERRED TO AS A HOT BOX.
- 6. ALL PIPE, VALVE, AND FITTING JOINTS, FROM THE SUPPLY MAIN, SHALL BE RESTRAINED.
- 7. THE BACKFLOW ASSEMBLY SHALL BE TESTED AFTER INSTALLATION AND PRIOR TO ACCEPTANCE AND ALSO YEARLY THEREAFTER BY A WASHINGTON STATE CERTIFIED BACKFLOW ASSEMBLY TESTER. TEST RESULTS SHALL BE SENT TO CLARK PUBLIC UTILITIES WATER SERVICES.

REVISED JANUARY 2026