


NOTES:

1. ALL CONSTRUCTION MATERIALS AND WORKMANSHIP SHALL CONFORM TO THE CLARK PUBLIC UTILITIES (CPU) WATER CONSTRUCTION SPECIFICATIONS, STANDARD DETAILS AND THE LATEST EDITION OF THE "STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION" PUBLISHED BY WASHINGTON STATE DEPARTMENT OF TRANSPORTATION (WSDOT).
2. A WATER UTILITY INSPECTOR SHALL BE AT THE JOB SITE DURING CONSTRUCTION OF ALL WATER FACILITIES. CONTACT 360-992-8022 TWO (2) WORKING DAYS PRIOR TO COMMENCING WORK.
3. WORK WITHIN COUNTY RIGHT-OF-WAY SHALL CONFORM WITH CLARK COUNTY PUBLIC WORKS UTILITY PERMIT REQUIREMENTS AND DETAILS. WORK WITHIN STATE RIGHT-OF-WAY SHALL CONFORM TO WSDOT UTILITY PERMIT REQUIREMENTS AND DETAILS.
4. THE LOCATION OF THE UTILITIES SHALL BE VERIFIED IN ADVANCE TO ALLOW FOR ALIGNMENT ADJUSTMENTS. CALL UTILITY LOCATES TWO (2) WORKING DAYS PRIOR TO CONSTRUCTION (1-800-553-4344).
5. A TAPPING COMPANY APPROVED BY CLARK PUBLIC UTILITIES SHALL BE USED TO MAKE ALL TAPS.
6. NO CONNECTIONS WILL BE ALLOWED TO AN EXISTING SERVICE PRIOR TO AN APPROVED BACTERIOLOGICAL TEST. BACTERIOLOGICAL TEST SHALL PRECEDE PRESSURE TEST.
7. SERVICES SHALL BE PRESSURE TESTED WITH THE MAIN LINE AND BE CAPABLE OF WITH-STANDING THE MAINS TEST PRESSURE.
8. ALL COMPRESSION FITTINGS TO HAVE STAINLESS STEEL INSERTS.
9. 1.5" AND 2" WATER METERS REQUIRE PREMISE ISOLATION BACKFLOW PROTECTION. TYPE OF BACKFLOW REQUIRED WILL BE BASED ON THE HIGHEST POTENTIAL HAZARD. UNLESS APPROVED, NO CONNECTIONS SHALL BE MADE BETWEEN THE METER AND PREMISE ISOLATION.

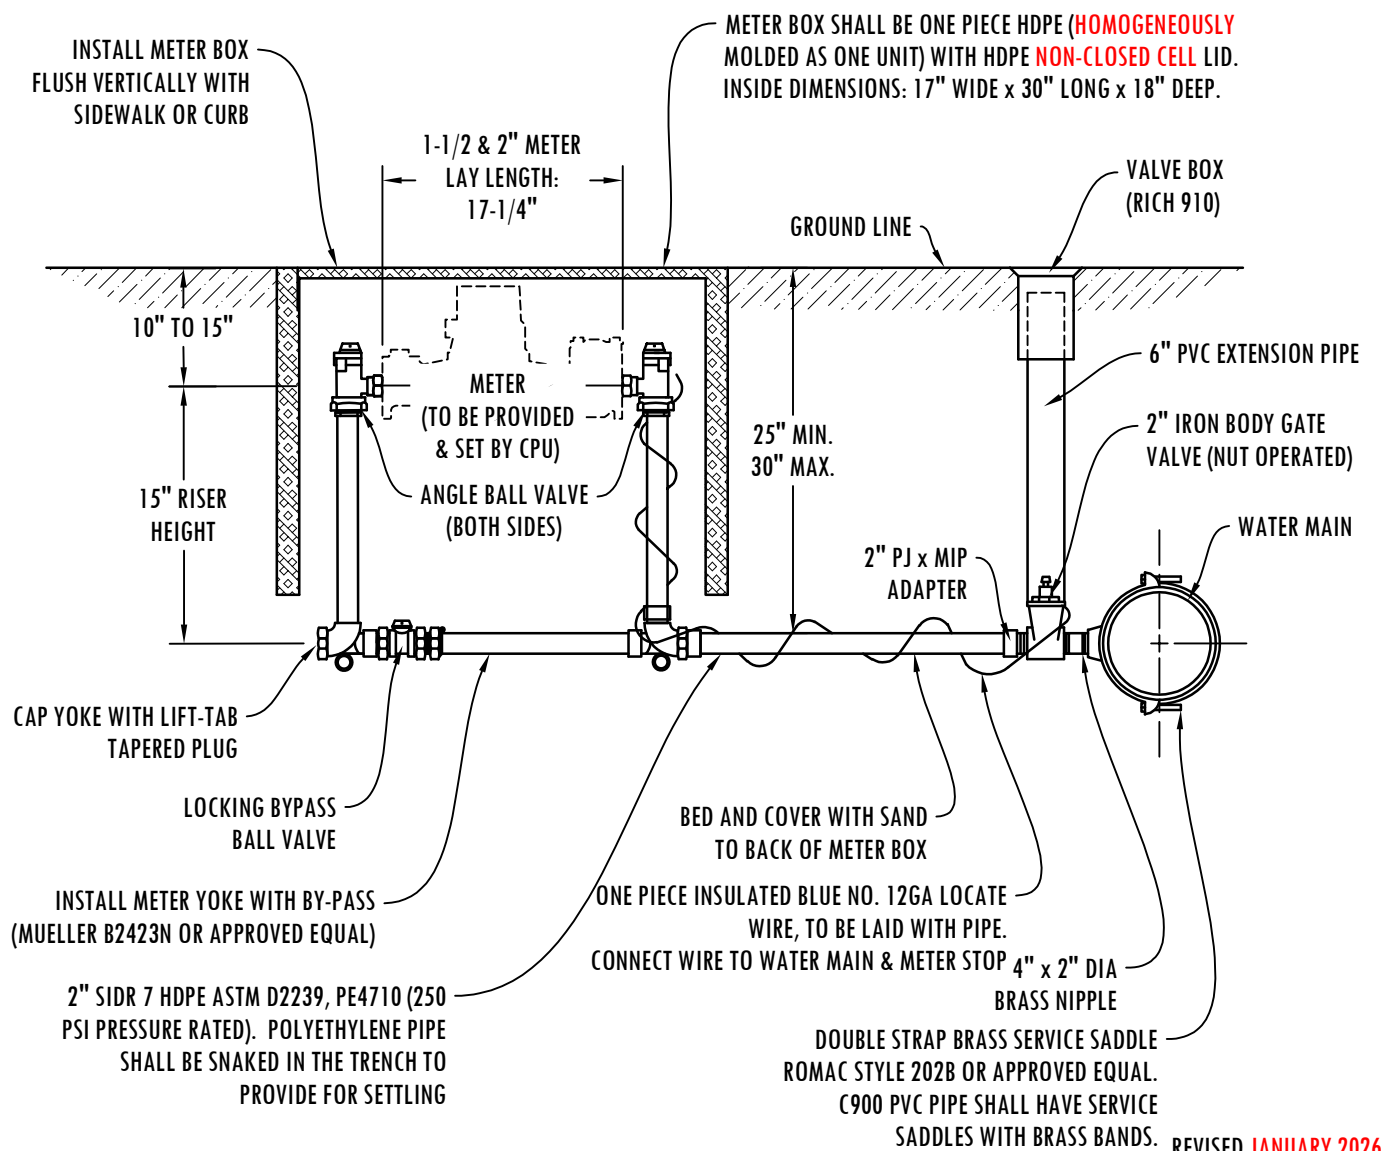

FILE NAME

2W

SHEET

1 OF 1

2" WATER SERVICE WITH
1-1/2" OR 2" WATER METER

STANDARD DETAILS

Clark
Public
Utilities

